

MARKETPLACE EAST PHASE 1
BRYANT REALTY COMPANY, LLC
DRAINAGE CALCULATIONS – SUMMARY
2/6/2023

DESCRIPTION OF PROJECT

Marketplace east phase 1 is an approximately 7.11 Acre development located in the City of Bryant, Arkansas approximately a quarter mile north of Market Place Avenue. There are two ridges that run through the site creating three main drainage basins. There is one large drainage basin among three basins that flows to pond on south side. There is an existing gravel road and 635 linear feet of gravel road is replaced by paved road.

Stormwater Calculations were prepared with the intent to comply with the City of Bryant's Drainage Code. Hydraulic calculations were made using the Rational Method. Design frequencies were analyzed for 2, 5, 10, 25, 50, and 100 year return periods.

These calculations are divided into the following sections:

Summary of Drainage Basins

Summary of Inlets

Summary of Pipes

Appendices

Exhibit A – Pre-Development Drainage Basins

Exhibit B – Post-Development Drainage Basins

MARKETPLACE EAST PHASE 1
BRYANT REALTY COMPANY, LLC
DRAINAGE CALCULATIONS – SUMMARY
2/6/2023

SUMMARY OF DRAINAGE BASINS

Basin 1 drains to western side and Basin 3 drains to eastern side of the site. Basin 3 and 4 is developed. Basin 2 is drained to a pond which is located in the south side of the site. There is no significant change between pre and post development discharges.

SUMMARY OF INLETS

On the drainage plan you will see labels for all of the inlets for these calculations. The flows shown are for the 10-year return storm. The distance from the face of the curb to the center of the street is 15 feet.

SUMMARY OF PIPES

All pipes used in this project are HDPE or RCP. Therefore, a manning's of 0.012 was used on all pipes in the analysis.

**Stormwater Calcs - Marketplace East Phase 1
Using Rational Method**

Pre-development

Calculated Tc values - Drainage Basin 1, 2 & 3

$$T_c = \frac{56 * L^{.6} * n^{.6}}{i^{.4} * S^{.3}} \text{ seconds}$$

L1 = 285 feet
n1 = 0.03
S1 = 0.032 ft/ft
I_{assumed} = 8.40 inches
T_c_{calculated} = 243 seconds
T_c_{calculated} = 4.05 minutes

T_c = 4.05 minutes
I = 8.40 inches

Use T_c = **5.00** minutes

T_c for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual
i for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual

I ₁₀₀ =	10 Inches	I ₁₀ =	7.2 Inches
I ₅₀ =	9.2 Inches	I ₅ =	6.5 Inches
I ₂₅ =	8.40 Inches	I ₂ =	5.6 Inches

**Stormwater Calcs - Marketplace East Phase 1
Using Rational Method**

Post-development

Calculated Tc values - Drainage Basin 1, 2 & 3

$$T_c = \frac{56 * L^{.6} * n^{.6}}{i^{.4} * S^{.3}} \text{ seconds}$$

L1 = 285 feet
n1 = 0.03
S1 = 0.032 ft/ft
I_{assumed} = 8.40 inches
T_c_{calculated} = 243 seconds
T_c_{calculated} = 4.05 minutes

Tc = 4.05 minutes
I = 8.40 inches

Use Tc = **5.00** minutes

Tc for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual
i for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual

I ₁₀₀ =	10 Inches	I ₁₀ =	7.2 Inches
I ₅₀ =	9.2 Inches	I ₅ =	6.5 Inches
I ₂₅ =	8.40 Inches	I ₂ =	5.6 Inches

**Stormwater Calcs - Marketplace East Phase 1
using Rational Method**

Pre-development

Calculated C values - Drainage Basin 1

	Area	C ₁₀₀	C ₅₀	C ₂₅	C ₁₀	C ₅	C ₂
Greenspace	0.15	0.49	0.45	0.42	0.38	0.36	0.33
Road	0.01	0.97	0.92	0.88	0.83	0.8	0.75
Total Area =	0.16	0.52	0.48	0.45	0.41	0.39	0.36

(C values taken from Table 400-2 of City of Bryant Drainage Manual)

Pasture, Average 2-7%

Road

Calculated C values - Drainage Basin 2

	Area	C ₁₀₀	C ₅₀	C ₂₅	C ₁₀	C ₅	C ₂
Greenspace	6.35	0.47	0.43	0.4	0.36	0.34	0.31
Gravel	0.16	0.65	0.55	0.5	0.35	0.3	0.25
Total Area =	6.51	0.47	0.43	0.40	0.36	0.34	0.31

(C values taken from Table 400-2 of City of Bryant Drainage Manual)

Forest/Woodlands, Average 2-7%

Gravel

Calculated C values - Drainage Basin 3

	Area	C ₁₀₀	C ₅₀	C ₂₅	C ₁₀	C ₅	C ₂
Greenspace	0.44	0.47	0.43	0.4	0.36	0.34	0.31
Total Area =	0.44	0.47	0.43	0.40	0.36	0.34	0.31

(C values taken from Table 400-2 of City of Bryant Drainage Manual)

Forest/Woodlands, Average 2-7%

Stormwater Calcs - Marketplace East Phase 1
using Rational Method

Post-development

Calculated C values - Drainage Basin 1

	Area	C ₁₀₀	C ₅₀	C ₂₅	C ₁₀	C ₅	C ₂
Greenspace	0.15	0.49	0.45	0.42	0.38	0.36	0.33
Road	0.01	0.97	0.92	0.88	0.83	0.8	0.75
Total Area =	0.16	0.52	0.48	0.45	0.41	0.39	0.36

(C values taken from Table 400-2 of City of Bryant Drainage Manual)

Pasture, Average 2-7%

Road

Calculated C values - Drainage Basin 2

	Area	C ₁₀₀	C ₅₀	C ₂₅	C ₁₀	C ₅	C ₂
Greenspace	6.34	0.47	0.43	0.4	0.36	0.34	0.31
Gravel	0.04	0.65	0.55	0.5	0.35	0.3	0.25
Road	0.13	0.97	0.92	0.88	0.83	0.8	0.75
Total Area =	6.51	0.48	0.44	0.41	0.37	0.35	0.32

(C values taken from Table 400-2 of City of Bryant Drainage Manual)

Forest/Woodlands, Average 2-7%

Gravel

Road

Calculated C values - Drainage Basin 3

	Area	C ₁₀₀	C ₅₀	C ₂₅	C ₁₀	C ₅	C ₂
Greenspace	0.44	0.47	0.43	0.4	0.36	0.34	0.31
Total Area =	0.44	0.47	0.43	0.40	0.36	0.34	0.31

(C values taken from Table 400-2 of City of Bryant Drainage Manual)

Forest/Woodlands, Average 2-7%

Stormwater Calcs - Marketplace East Phase 1
using Rational Method

Pre-development

Drainage Basin 1

Q₁₀₀ = 0.83 CFS
c = 0.52
i = 10.00 in/hr
A = 0.16 acres

Q₆₀ = 0.71 CFS
c = 0.48
i = 9.20 in/hr
A = 0.16 acres

Q₂₅ = 0.60 CFS
c = 0.45
i = 8.40 in/hr
A = 0.16 acres

Q₁₀ = 0.47 CFS
c = 0.41
i = 7.20 in/hr
A = 0.16 acres

Q₅ = 0.40 CFS
c = 0.39
i = 6.50 in/hr
A = 0.16 acres

Q₂ = 0.32 CFS
c = 0.36
i = 5.60 in/hr
A = 0.16 acres

Drainage Basin 2

Q₁₀₀ = 30.89 CFS
c = 0.47
i = 10.00 in/hr
A = 6.51 acres

Q₆₀ = 28.71 CFS
c = 0.48
i = 9.20 in/hr
A = 6.51 acres

Q₂₅ = 22.01 CFS
c = 0.40
i = 8.40 in/hr
A = 6.51 acres

Q₁₀ = 16.86 CFS
c = 0.36
i = 7.20 in/hr
A = 6.51 acres

Q₅ = 14.35 CFS
c = 0.34
i = 6.50 in/hr
A = 6.51 acres

Q₂ = 11.25 CFS
c = 0.31
i = 5.60 in/hr
A = 6.51 acres

Drainage Basin 3

Q₁₀₀ = 2.07 CFS
c = 0.47
i = 10.00 in/hr
A = 0.44 acres

Q₆₀ = 1.74 CFS
c = 0.43
i = 9.20 in/hr
A = 0.44 acres

Q₂₅ = 1.48 CFS
c = 0.40
i = 8.40 in/hr
A = 0.44 acres

Q₁₀ = 1.14 CFS
c = 0.36
i = 7.20 in/hr
A = 0.44 acres

Q₅ = 0.97 CFS
c = 0.34
i = 6.50 in/hr
A = 0.44 acres

Q₂ = 0.76 CFS
c = 0.31
i = 5.60 in/hr
A = 0.44 acres

Post-development

Drainage Basin 1

Q₁₀₀ = 0.83 CFS
c = 0.52
i = 10.00 in/hr
A = 0.16 acres

Q₆₀ = 0.71 CFS
c = 0.48
i = 9.20 in/hr
A = 0.16 acres

Q₂₅ = 0.60 CFS
c = 0.45
i = 8.40 in/hr
A = 0.16 acres

Q₁₀ = 0.47 CFS
c = 0.41
i = 7.20 in/hr
A = 0.16 acres

Q₅ = 0.40 CFS
c = 0.39
i = 6.50 in/hr
A = 0.16 acres

Q₂ = 0.32 CFS
c = 0.36
i = 5.60 in/hr
A = 0.16 acres

Drainage Basin 2

Q₁₀₀ = 31.32 CFS
c = 0.48
i = 10.00 in/hr
A = 6.51 acres

Q₆₀ = 26.38 CFS
c = 0.44
i = 9.20 in/hr
A = 6.51 acres

Q₂₅ = 22.43 CFS
c = 0.41
i = 8.40 in/hr
A = 6.51 acres

Q₁₀ = 17.31 CFS
c = 0.37
i = 7.20 in/hr
A = 6.51 acres

Q₅ = 14.77 CFS
c = 0.35
i = 6.50 in/hr
A = 6.51 acres

Q₂ = 11.61 CFS
c = 0.32
i = 5.60 in/hr
A = 6.51 acres

Drainage Basin 3

Q₁₀₀ = 2.07 CFS
c = 0.47
i = 10.00 in/hr
A = 0.44 acres



Q₆₀ = 1.74 CFS
c = 0.43
i = 9.20 in/hr
A = 0.44 acres

Q₂₅ = 1.48 CFS
c = 0.40
i = 8.40 in/hr
A = 0.44 acres

Q₁₀ = 1.14 CFS
c = 0.36
i = 7.20 in/hr
A = 0.44 acres

Q₅ = 0.97 CFS
c = 0.34
i = 6.50 in/hr
A = 0.44 acres

Q₂ = 0.76 CFS
c = 0.31
i = 5.60 in/hr
A = 0.44 acres

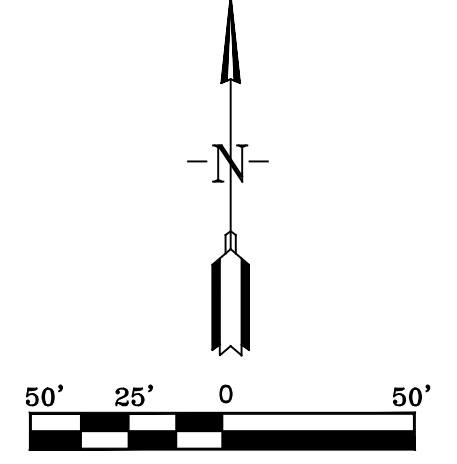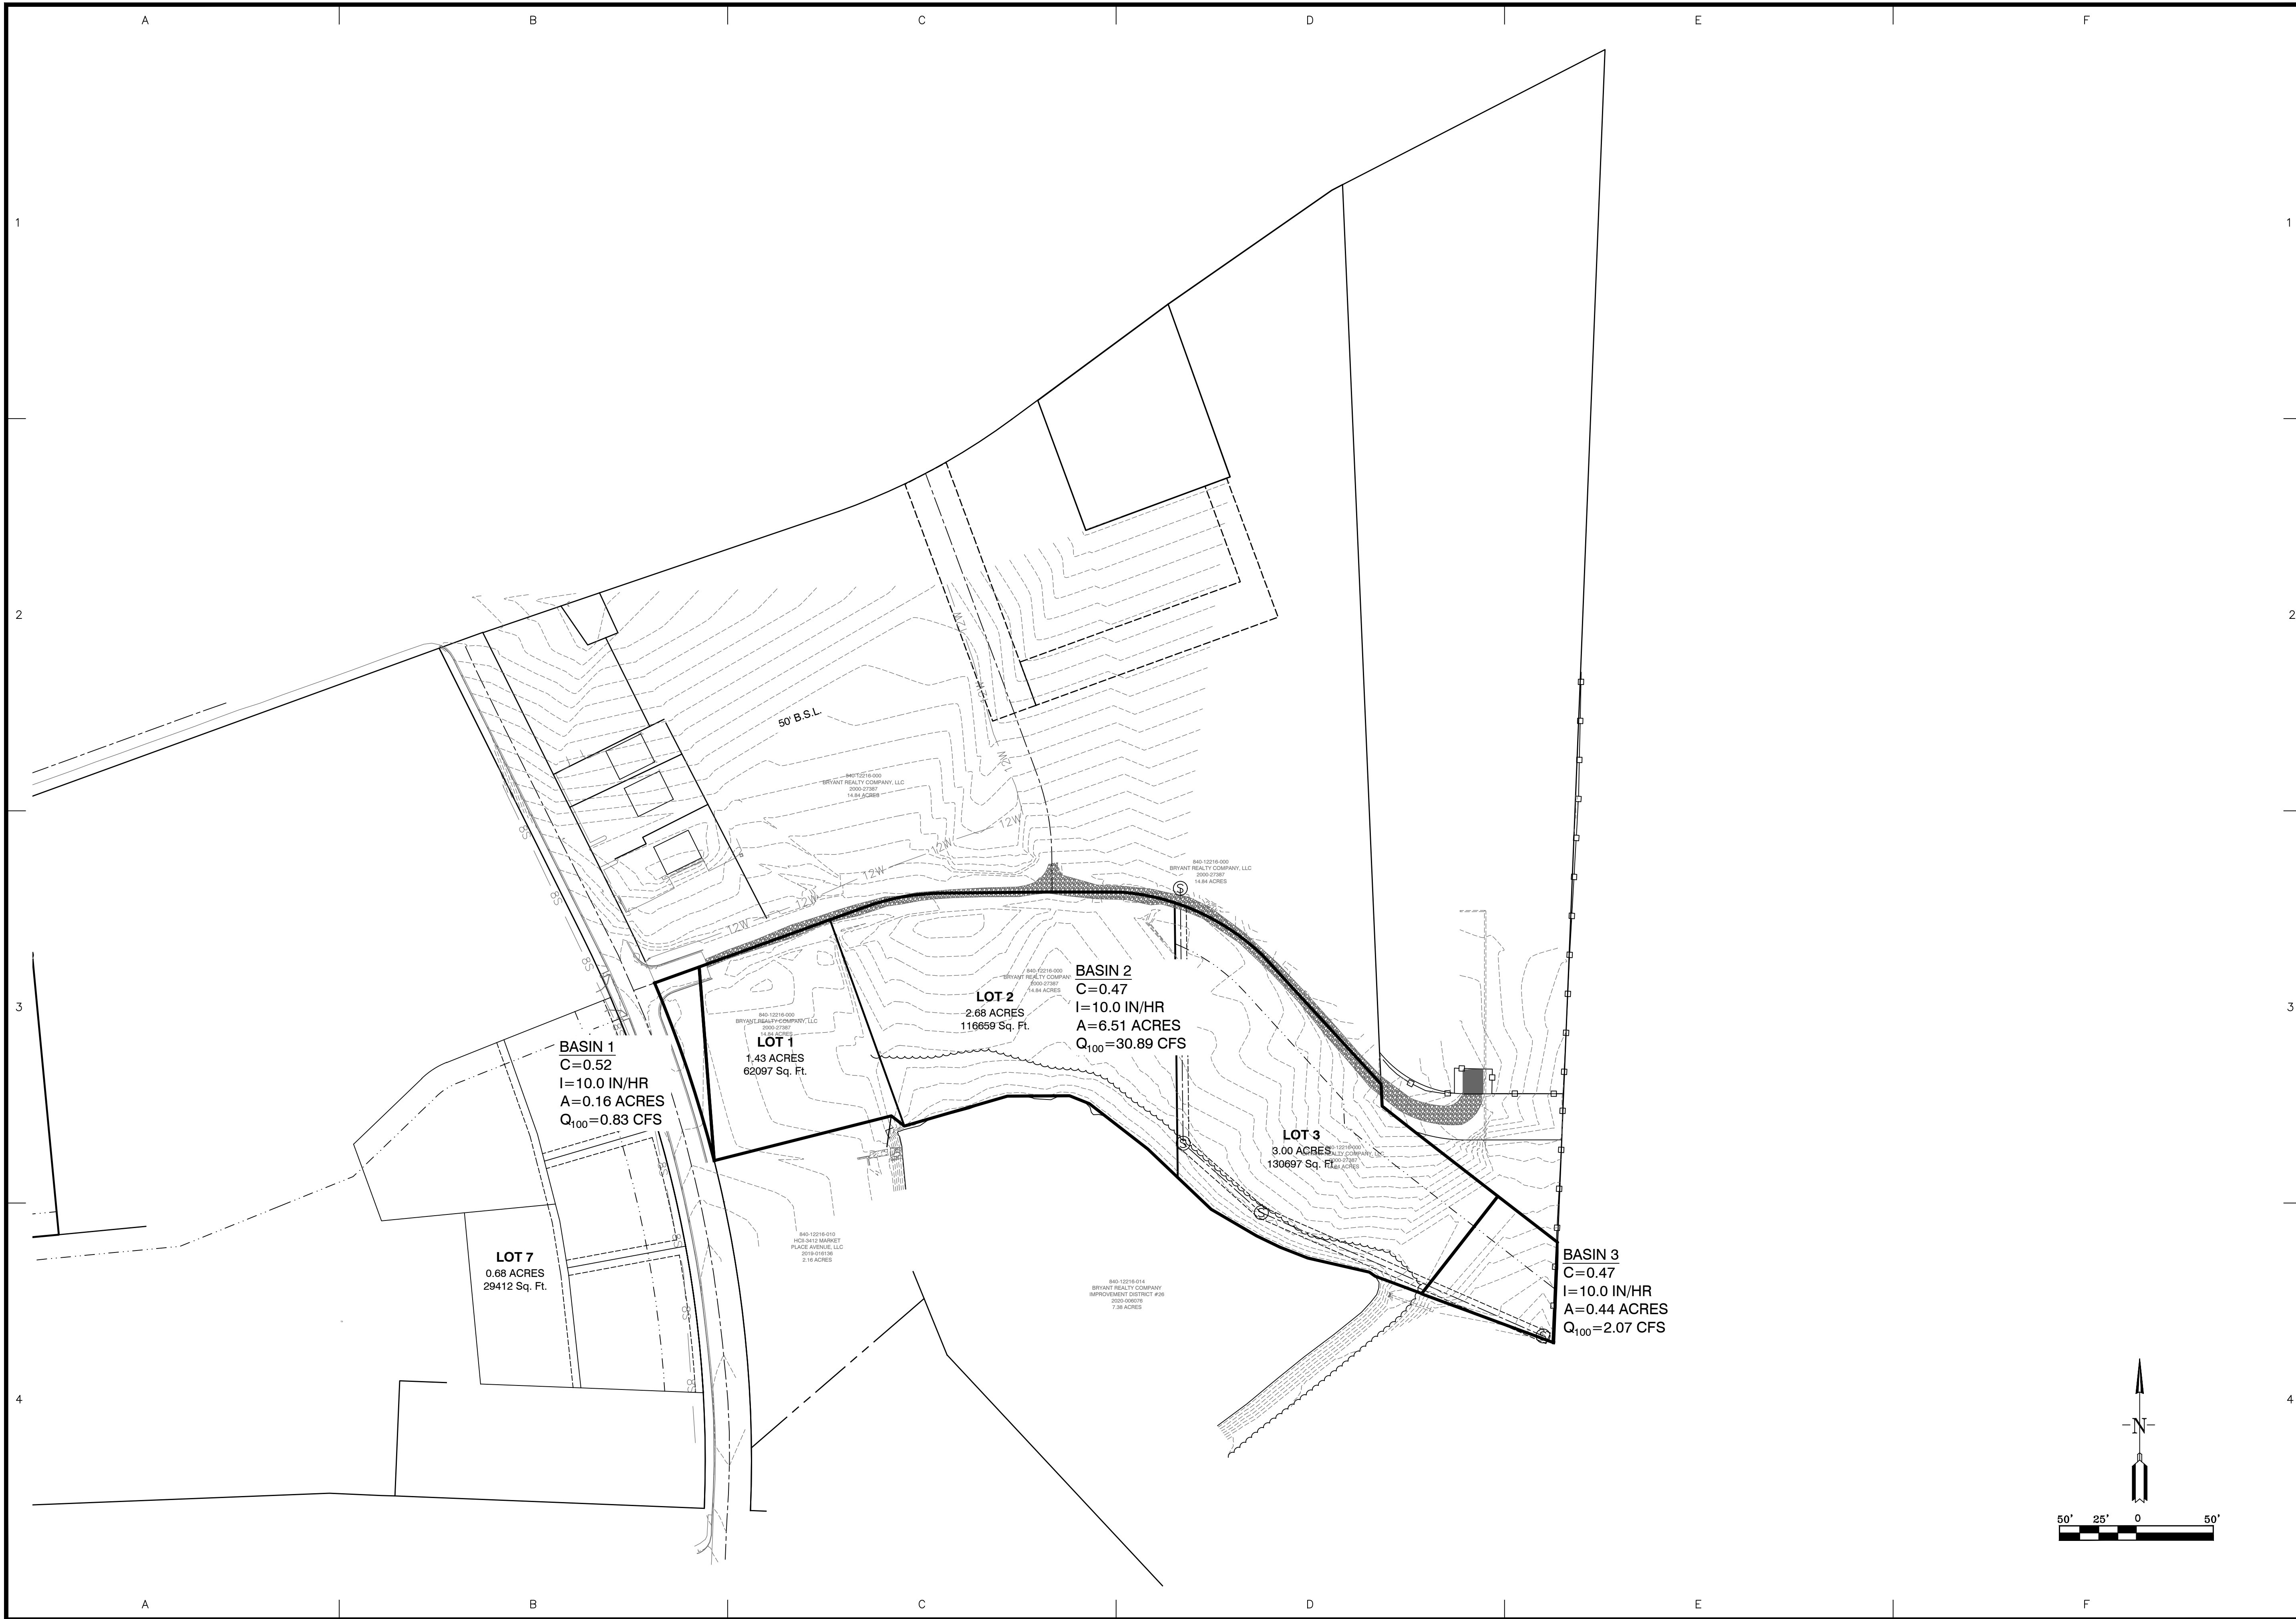

<p>GN Designing our client's success GarNat Engineering, LLC P.O. Box 116 Benton, AR 72018 Ph: (501) 408-4650 garnatengineering@gmail.com</p>		<p>REVISION</p>
<p>MARKETPLACE EAST PHASE 1 BRYANT REALTY COMPANY, LLC CITY OF BRYANT SALINE COUNTY, ARKANSAS</p>		<p>DATE</p>
<p>CONTENTS:</p> <p>PRE DRAINAGE BASIN</p>		<p>BY</p>
<p>PROJECT NO: 20022</p>		<p>DATE</p>
<p>DATE: FEBRUARY, 2023</p>		<p>BY</p>
<p>SHEET NO: 2.0</p>		<p>DATE</p>

A:\Projects\2022 Projects\2022 Bart Ferguson - John Danks - 1.0001.001 - Bryant, Other Cities\Drainage\DWG\Design\00022 Bart Ferguson Marketplace East Subdivision\Drainage 02-23.dwg

Stormwater Calcs - Bryant Ortho Clinic
Using Rational Method

Post-development Basin

Calculated Tc values - Drainage Basin CI-1-2 & CI 1-3

$$T_c = \frac{56 * L^{1.6} * n^{1.6}}{i^{1.4} * S^{1.3}} \text{ seconds}$$

L1 = 525 feet
 n1 = 0.075 Sluggish reaches, weedy, deep pools
 S1 = 0.04 ft/ft
 I_{assumed} = 6.80 inches
 T_ccalculated = 619 seconds
 T_ccalculated = 10.32 minutes
 Tc = 10.32 minutes
 I = 6.80 inches
 Use Tc = 10.00 minutes

Tc for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual
 i for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual

Calculated Tc values - Drainage Basin CI-1-4

$$T_c = \frac{56 * L^{1.6} * n^{1.6}}{i^{1.4} * S^{1.3}} \text{ seconds}$$

L1 = 275 feet
 n1 = 0.033 Gravel
 S1 = 0.04 ft/ft
 I_{assumed} = 8.40 inches
 T_ccalculated = 236 seconds
 T_ccalculated = 3.93 minutes
 Tc = 3.93 minutes
 I = 8.40 inches
 Use Tc = 5.00 minutes

Tc for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual
 i for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual

Calculated Tc values - Drainage Basin CI-2-2

$$T_c = \frac{56 * L^{1.6} * n^{1.6}}{i^{1.4} * S^{1.3}} \text{ seconds}$$

L1 = 440 feet
 n1 = 0.075 Sluggish reaches, weedy, deep pools
 S1 = 0.04 ft/ft
 I_{assumed} = 7.00 inches
 T_ccalculated = 550 seconds
 T_ccalculated = 9.17 minutes
 Tc = 9.17 minutes
 I = 7.00 inches
 Use Tc = 9.00 minutes

Tc for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual
 i for 25-yr Storm from Exhibit 400-1 of Bryant Drainage Manual

Stormwater Calcs - Bryant Ortho Clinic
 using Rational Method
 POST-DEV C VALUES

CI-1-1					
Area	C ₁₀	C ₂₅	C ₁₀₀	(C values taken from Table 400-2 of City of Bryant Drainage Manual)	
0.17	0.36	0.4	0.47	Forest/Woodlands, Average 2-7%	
0.07	0.35	0.5	0.65	Gravel	
Total Area =	0.24	0.36	0.43	0.52	

CI-1-2					
Area	C ₁₀	C ₂₅	C ₁₀₀	(C values taken from Table 400-2 of City of Bryant Drainage Manual)	
0.07	0.35	0.5	0.65	Gravel	
2.67	0.36	0.4	0.47	Forest/Woodlands, Average 2-7%	
Total Area =	2.74	0.36	0.40	0.47	

CI-1-3					
Area	C ₁₀	C ₂₅	C ₁₀₀	(C values taken from Table 400-2 of City of Bryant Drainage Manual)	
0.23	0.35	0.5	0.65	Gravel	
2.02	0.36	0.4	0.47	Forest/Woodlands, Average 2-7%	
Total Area =	2.25	0.36	0.41	0.49	

CI-1-4

Area	C ₁₀	C ₂₅	C ₁₀₀	(C values taken from Table 400-2 of City of Bryant Drainage Manual)
0.23	0.35	0.5	0.65	Gravel
0.30	0.36	0.4	0.47	Forest/Woodlands, Average 2-7%
Total Area = 0.53	0.36	0.44	0.55	

CI-2-1

Area	C ₁₀	C ₂₅	C ₁₀₀	(C values taken from Table 400-2 of City of Bryant Drainage Manual)
0.22	0.43	0.46	0.53	Poor Condition, Average 2-7%
0.10	0.81	0.86	0.95	Asphalt
Total Area = 0.32	0.55	0.59	0.66	

CI-2-2

Area	C ₁₀	C ₂₅	C ₁₀₀	(C values taken from Table 400-2 of City of Bryant Drainage Manual)
0.10	0.81	0.86	0.95	Asphalt
3.67	0.36	0.4	0.47	Forest/Woodlands, Average 2-7%
Total Area = 3.77	0.37	0.41	0.48	

Stormwater Calcs - Bryant Ortho Clinic
using Rational Method
Post Development Flowrates

CI-1-1

$Q_{10} =$ 0.62 CFS
 $c =$ 0.36
 $i =$ 7.20 in/hr
 $A =$ 0.24 acres

CI-1-2

$Q_{10} =$ 5.91 CFS
 $c =$ 0.36
 $i =$ 6.00 in/hr
 $A =$ 2.74 acres

CI-1-3

$Q_{10} =$ 4.85 CFS
 $c =$ 0.36
 $i =$ 6.00 in/hr
 $A =$ 2.25 acres

CI-1-4

$Q_{10} =$ 1.36 CFS
 $c =$ 0.36
 $i =$ 7.20 in/hr
 $A =$ 0.53 acres

CI-2-1

$Q_{10} =$ 1.21 CFS
 $c =$ 0.55
 $i =$ 6.90 in/hr
 $A =$ 0.32 acres

CI-2-2

$Q_{10} =$ 8.69 CFS
 $c =$ 0.37
 $i =$ 6.20 in/hr
 $A =$ 3.77 acres

BRYANT ORTHO CLINIC GUTTER SPREAD 10-YR STORM

CI 1-1

$$T = \left(\frac{Q * n}{k_u * S_x^{1.67} * S_L^{0.5}} \right)^{.375}$$

Q	0.62 cfs
n	0.012
k _u	0.56
S _x	0.03
S _L	0.03
T	<u>3.43</u> ft

Q= Flowrate(cfs)
n=manning's number
k=0.56
S_x= cross slope
S_L= longitudinal slope
T= Gutter Spread

CI 1-2

$$T = \left(\frac{Q * n}{k_u * S_x^{1.67} * S_L^{0.5}} \right)^{.375}$$

Q	5.91 cfs
n	0.012
k _u	0.56
S _x	0.03
S _L	0.03
T	<u>8.00</u> ft

CI 1-3

$$T = \left(\frac{Q * n}{k_u * S_x^{1.67} * S_L^{0.5}} \right)^{.375}$$

Q	4.85 cfs
n	0.012
k _u	0.56
S _x	0.03
S _L	0.03
T	<u>7.52</u> ft

CI 1-4

$$T = \left(\frac{Q * n}{k_u * S_x^{1.67} * S_L^{0.5}} \right)^{.375}$$

Q	1.36 cfs
n	0.012
k _u	0.56
S _x	0.03
S _L	0.03
T	<u>4.66</u> ft

CI 2-1

$$T = \left(\frac{Q * n}{k_u * S_x^{1.67} * S_L^{0.5}} \right)^{.375}$$

Q	1.21 cfs
n	0.012
k _u	0.56
S _x	0.03
S _L	0.03
T	<u>4.41</u> ft

CI 2-2

$$T = \left(\frac{Q * n}{k_u * S_x^{1.67} * S_L^{0.5}} \right)^{.375}$$

Q	8.69 cfs
n	0.012
k _u	0.56
S _x	0.03
S _L	0.03
T	<u>9.36</u> ft

Stormwater Calcs - Bryant Ortho Clinic

10-YEAR STORM

Area #	Area	I	C	Weir			Required L (ft)	Actual L (ft)	
				Q (cfs)	$Q=3.0LY^{1.5}$ Q (cfs)	Y (ft)			
CI-1-1	0.24	7.20	0.36	0.62	0.62	0.49	0.60	4	4' box
CI-1-2	2.74	6.00	0.36	5.91	5.91	0.49	5.75	7	4' box with 3' wing
CI-1-3	2.25	6.00	0.36	4.85	4.85	0.49	4.71	7	4' box with 3' wing
CI-1-4	0.53	7.20	0.36	1.36	1.36	0.49	1.32	4	4' box
CI-2-1	0.32	6.90	0.55	1.21	1.21	0.49	1.18	4	4' box
CI-2-2	3.77	6.20	0.37	8.69	8.69	0.49	8.45	10	4' box with 2-3' wing

Bryant Ortho Clinic - Culvert Capacity

ON SITE DRAINAGE

Pipe Name	From	To	Design Flow (cfs)	Slope (ft/ft)	Diameter (inches)	No. Pipes	Manning's	Area Full (sf)	Wetted Perimeter Full (ft)	Hydraulic Radius Full (ft)	Flow Capacity (cfs)	% Capacity
PIPE 119	CI 1-2	CI 1-1	12.12	0.0100	24	1	0.012	3.14	6.283	0.5	24.51	49%
PIPE 120	CI 1-3	CI 1-2	6.20	0.0100	18	1	0.012	1.77	4.712	0.375	11.38	55%
PIPE 121	CI 1-4	CI 1-3	1.36	0.0100	18	1	0.012	1.77	4.712	0.375	11.38	12%
PIPE 122	CI 2-2	CI 2-1	8.69	0.0100	18	1	0.012	1.77	4.712	0.375	11.38	76%